



Bussbar configuration (top view)

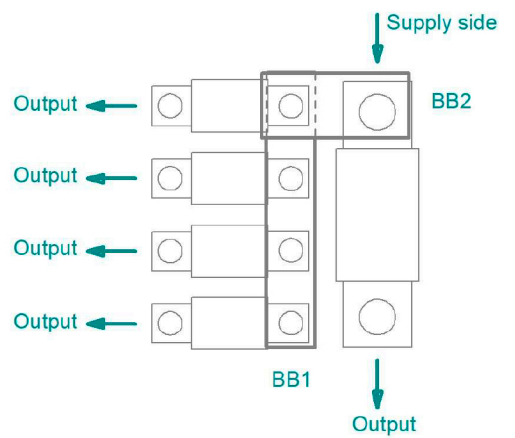

Note: BB2 can be placed on other side of megaOTO fuse, also switching supply and output

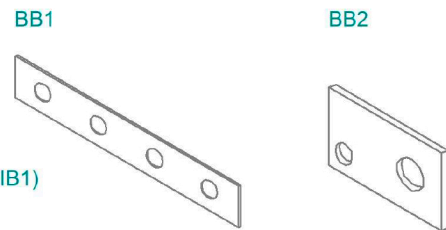

Additional information:
 Bussbar dimensions: BB1 1.5x12x67mm, BB2 1.80x15x33.5mm (WxHxL)
 Bussbar dimension tolerance: W: ± 0.3mm, H: ± 0.5mm, L: ± 1.0mm
 Bussbar material: Copper, Cu
 Max fuse rating: 4 x 200A midiOTO, megaOTO not limited
 For system voltages between 32 and 70 VDC, mount holder on insulating base (i.e. HIB1)
 Torque range ISO: midiOTO (M5) 4.5 ± 1 Nm, megaOTO (M8) 12 ± 1 Nm

Revisions		Date	Appr.		
	Date	Type	Drawn	04/09	GRH
a	06/10	added cable hole dimensions	Checked	07/24	AdH
b	02/11	updated dimensions	Standards		
c	07/11	added bussbar tolerances	Approved	07/24	BE
d	03/18	updated dimensions			
e	02/20	production start new tool	Scale	1 : 2	
f	04/24	updated mounting torque to ISO	Projection	Tolerance ± 1 mm unless otherwise noted	Title
g	07/24	updated notes, higher VDC use			Drawing type
					Drawing number
					Sheet
					Layers / Sheet
					0 1 2 3 6 8 9 11 Sheet 01